

DOT 4BW 500
LOT 55K 056
FIKE M5698
01 EST 18



HFC-125 Clean Agent Extinguishing System
Fike® HFC-125 is Manufactured by
 HONEYWELL INTERNATIONAL INC
 www.FIKE.COM 115 TABOR ROAD • MORRIS PLAINS, NJ • 07950-2456 USA
 1-877-841-2840 02-10275 REV D

- 1 HEALTH
- 0 FLAMMABILITY
- 1 REACTIVITY
- X PROTECTIVE EQUIPMENT

RECYCLING PROTECTS THE ENVIRONMENT.
 DO NOT DISPOSE, DISCHARGE ONLY IN
 CASE OF FIRE.

IF CONTAINER CONTENTS MUST BE REMOVED FOR SERVICE, MAINTENANCE OR DISMANTLING OF THE CLEAN AGENT SYSTEM - PRIOR TO REMOVAL, CONTACT YOUR LOCAL INSTALLER OR MANUFACTURER FOR INSTRUCTIONS ON HANDLING EQUIPMENT AND RECLAIMING OR RECYCLING CLEAN AGENT.

THIS SYSTEM IS MADE UP OF UNITS TESTED WITHIN LIMITATIONS CONTAINED IN THE DETAILED INSTALLATION MANUAL. THE SYSTEM DESIGNER MUST BE CONSULTED WHENEVER CHANGES ARE PLANNED FOR THE SYSTEM OR AREA OF PROTECTION. AN AUTHORIZED INSTALLER OR SYSTEM DESIGNER MUST BE CONSULTED AFTER THE SYSTEM HAS DISCHARGED.

DO NOT COVER, REMOVE OR DEFACE THIS LABEL

HFC-125 EXTINGUISHING SYSTEM **Fike**®
 www.FIKE.COM

INSTALLATION: SEE FIKE SYSTEM INSTALLATION, OPERATING AND MAINTENANCE MANUALS.
CONTAINER STORAGE TEMPERATURE: 32°F TO 125°F (0°C TO 52°C)
OPERATION: IN CASE OF FIRE OPERATE MANUAL RELEASE AND FOLLOW THE STANDARD ON CLEAN AGENT FIRE EXTINGUISHING FOR COMPLETE DETAILS. SYSTEM MUST BE MAINTAINED BY FIKE
EVERY 6 MONTHS: CHECK ALL ELECTRICAL CONNECTIONS FOR CORROSION. SHALL BE RECHARGED IF THE AGENT WEIGHT LOSS EXCEEDS 10%
EVERY MONTH: OR AT MORE FREQUENT INTERVALS WHEN UNDER PRESSURE. 360 PSIG @ 70°F (25 BAR @ 21°C) (MAX SHALL BE 380 PSIG @ 70°F (26 BAR @ 21°C))

ASSEMBLY NO. 71-200-0
 SERIAL NO. 100000
 MANUFACTURING DATE: 000000
 CONTAINER SHIPMENT VERTICAL ONLY

WARNING:
 CONTAINER CAN EXPLODE IF HEATED.
 MAY EXPLODE IF HEATED.

STORAGE:
 STORE IN A WELL VENTILATED PLACE.
 PROTECT FROM DIRECT SUNLIGHT.





HFC-125
EXTINGUISHING
SYSTEM

Fike[®]
www.fike.com

704 SW 10TH STREET
BLUE SPRINGS, MO
64015

COVERED BY
PATENTS AND
PATENTS PENDING
MADE IN THE U.S.A.



02-12070 REV. 8

INSTALLATION: SEE FIKE SYSTEM INSTALLATION, OPERATION AND MAINTENANCE MANUAL 06-431 FOR COMPLETE DETAILS. CONTACT FIKE FOR COPIES OF THIS MANUAL.

CONTAINER STORAGE TEMPERATURE: 32°F TO 120°F [0°C TO 49°C]. CONTAINER TESTED TO 1000 PSIG [69 BAR].

OPERATION: IN CASE OF FIRE OPERATE MANUAL RELEASE AND CONTACT YOUR LOCAL FIRE DEPARTMENT.

MAINTENANCE: FOLLOW THE STANDARD ON CLEAN AGENT FIRE EXTINGUISHING SYSTEMS, NFPA 2001 AND SYSTEM INSTALLATION, OPERATION, AND MAINTENANCE MANUAL FOR COMPLETE DETAILS. SYSTEM MUST BE MAINTAINED BY TRAINED AND AUTHORIZED PERSONNEL ONLY.

EVERY 6 MONTHS: CHECK ALL ELECTRICAL CONNECTIONS FOR CORROSION. CHECK PIPING AND NOZZLES FOR OBSTRUCTIONS. REMOVE AND WEIGH EACH CONTAINER. UNIT SHALL BE RECHARGED IF THE AGENT WEIGHT LOSS EXCEEDS 5%.

EVERY MONTH: OR AT MORE FREQUENT INTERVALS WHEN CIRCUMSTANCES REQUIRE. CHECK NOZZLES FOR OBSTRUCTIONS. CHECK PRESSURE GAUGE FOR PROPER PRESSURE. 360 PSIG @ 70°F [25 BAR @ 21°C]. UNIT SHALL BE RECHARGED IF THE LOSS IN PRESSURE, ADJUSTED FOR TEMPERATURE, EXCEEDS 10%.

ASSEMBLY NO. 70 - 269 - D - W	GROSS WT. 192.0	UN 3220 PENTAFLUOROETHANE (HFC-125)
SERIAL NO. 1825651	TARE WT.	
MANUFACTURING DATE. 06/12/18	HFC-125 WT. 192.0	


CONTAINER SHIPMENT VERTICAL ONLY Y



WARNING:
CONTAINS GAS UNDER HIGH PRESSURE;
MAY EXPLODE IF HEATED.

STORAGE:
STORE IN A WELL VENTILATED PLACE.
PROTECT FROM DIRECT SUNLIGHT.

SUPPLEMENTARY INFORMATION:
THE DISCHARGE OF CLEAN AGENT SYSTEMS TO EXTINGUISH A FIRE CAN RESULT IN A POTENTIAL HAZARD TO PERSONNEL FROM THE NATURAL FORM OF THE CLEAN AGENT OR FROM THE PRODUCTS OF COMBUSTION THAT RESULT FROM EXPOSURE OF THE AGENT TO THE FIRE OR HOT SURFACES.
UNNECESSARY EXPOSURE OF PERSONNEL EITHER TO THE NATURAL AGENT OR TO THE PRODUCTS OF DECOMPOSITION SHALL BE AVOIDED.
DO NOT COVER, REMOVE, OR DEFACE THIS LABEL.

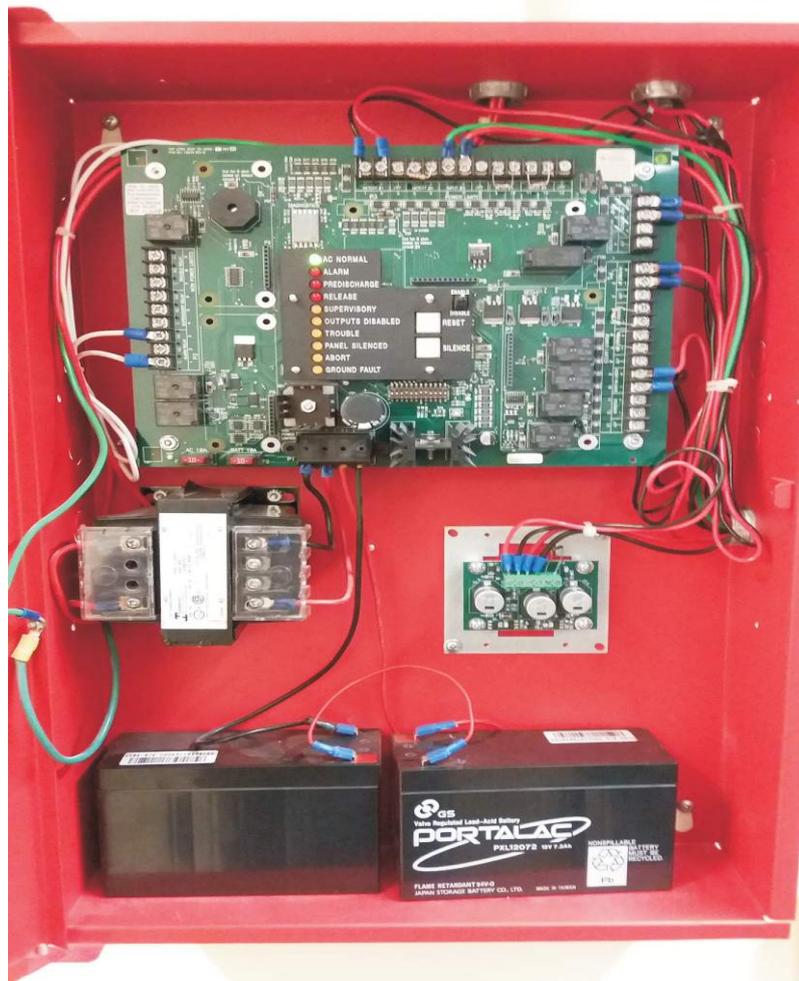

AC
100V